


INSTALL PIPE SUPPORT UNDER 2" WATER METER

PLAN

BACKFILL AROUND VAULT WITH CRUSHED SURFACING BASE COURSE, OR NATIVE MATERIAL (IF APPROVED BY UHWA) COMPACTED TO 95% MODIFIED PROCTOR PER ASTM D1557.

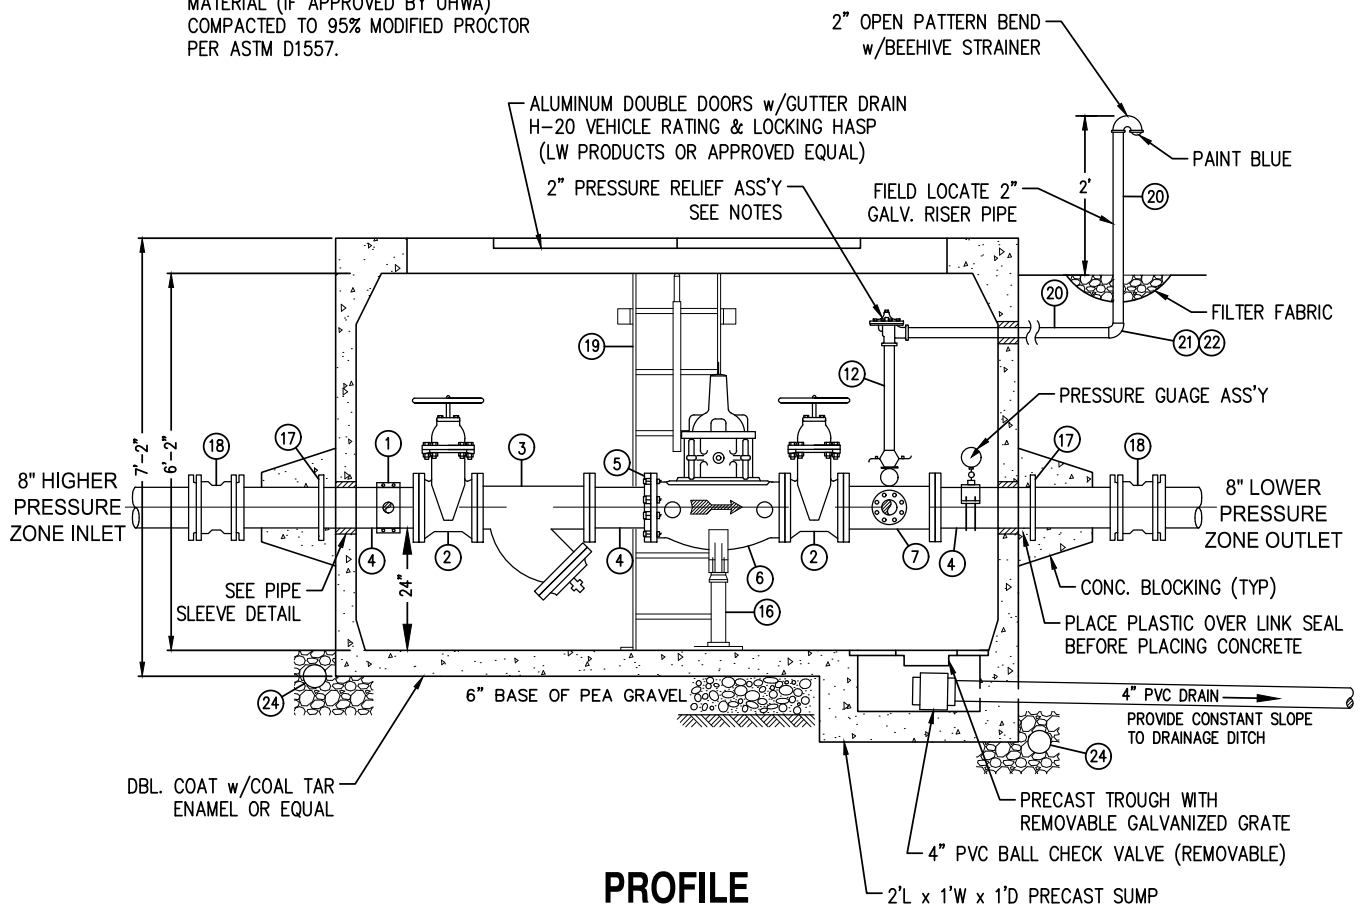

PROFILE

8" PRESSURE REDUCING STATION

1 OF 2

UNION HILL

WATER ASSOCIATION

WATER STANDARD DETAIL
W-42

SCALE: NTS DATE: JUNE 10, 2019

R:\CAD\DETAIL\AUTOCAD\UHWA\W-42 8IN PRV