


NOTE: TAP FOR AIR AND VACUUM VALVE ASSEMBLY MUST BE INSTALLED AT HIGHEST POINT OF WATER MAIN. EXACT LOCATION OF ASSEMBLY TO BE DETERMINED BY ASSOCIATION.

NOTE: ALL BRASS FITTINGS AND VALVES TO BE NO LEAD AND APPROVED FOR POTABLE DRINKING WATER.

VALVE ASSEMBLY DETAIL

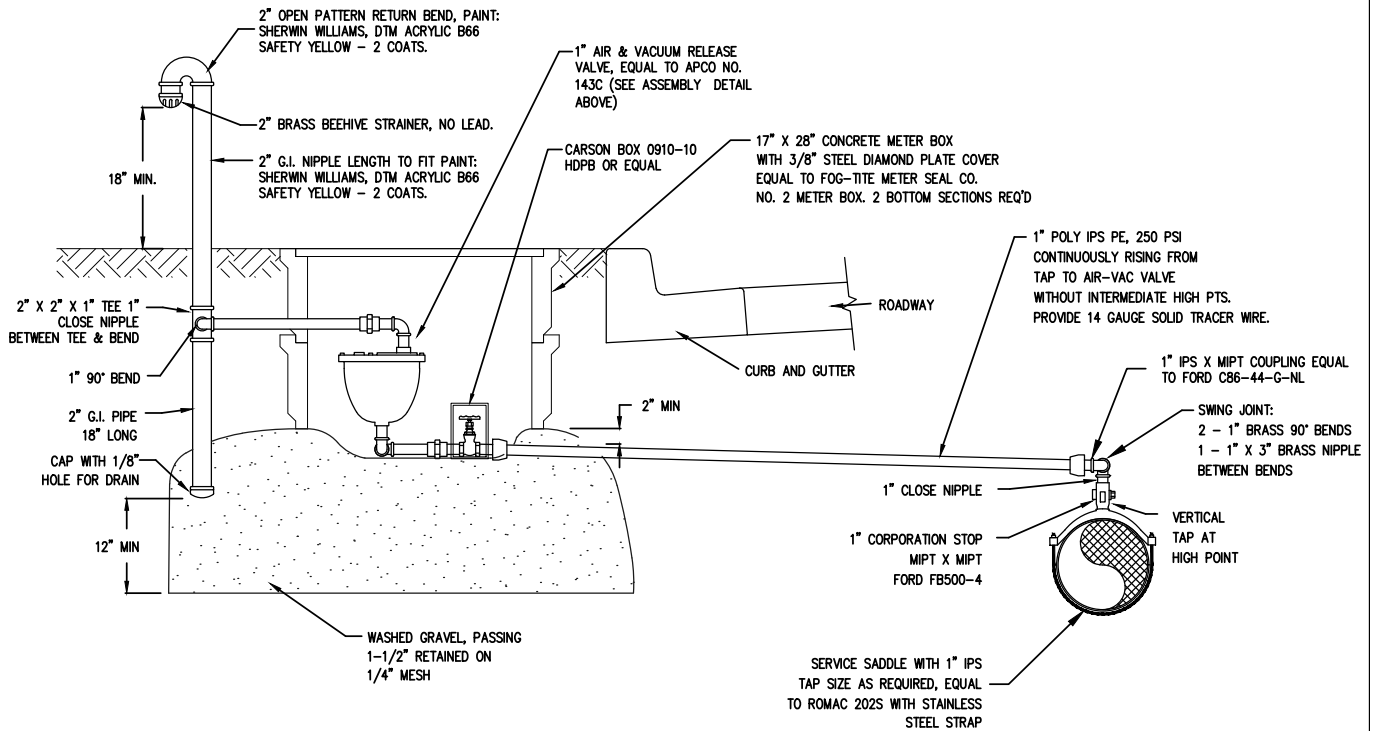

PROFILE

NTS

1" AIR AND VACUUM VALVE ASSEMBLY

**UNION HILL
WATER ASSOCIATION**

**WATER STANDARD DETAIL
W-16**

SCALE: NTS DATE: JUNE 10, 2019

R:\CAD\DETAIL\AUTOCAD\UHHW\W-16 1IN VAC