


PLAN

BACKFILL AROUND VAULT WITH CRUSHED SURFACING BASE COURSE, OR NATIVE MATERIAL (IF APPROVED BY UHWA) COMPACTED TO 95% MODIFIED PROCTOR PER ASTM D1557.

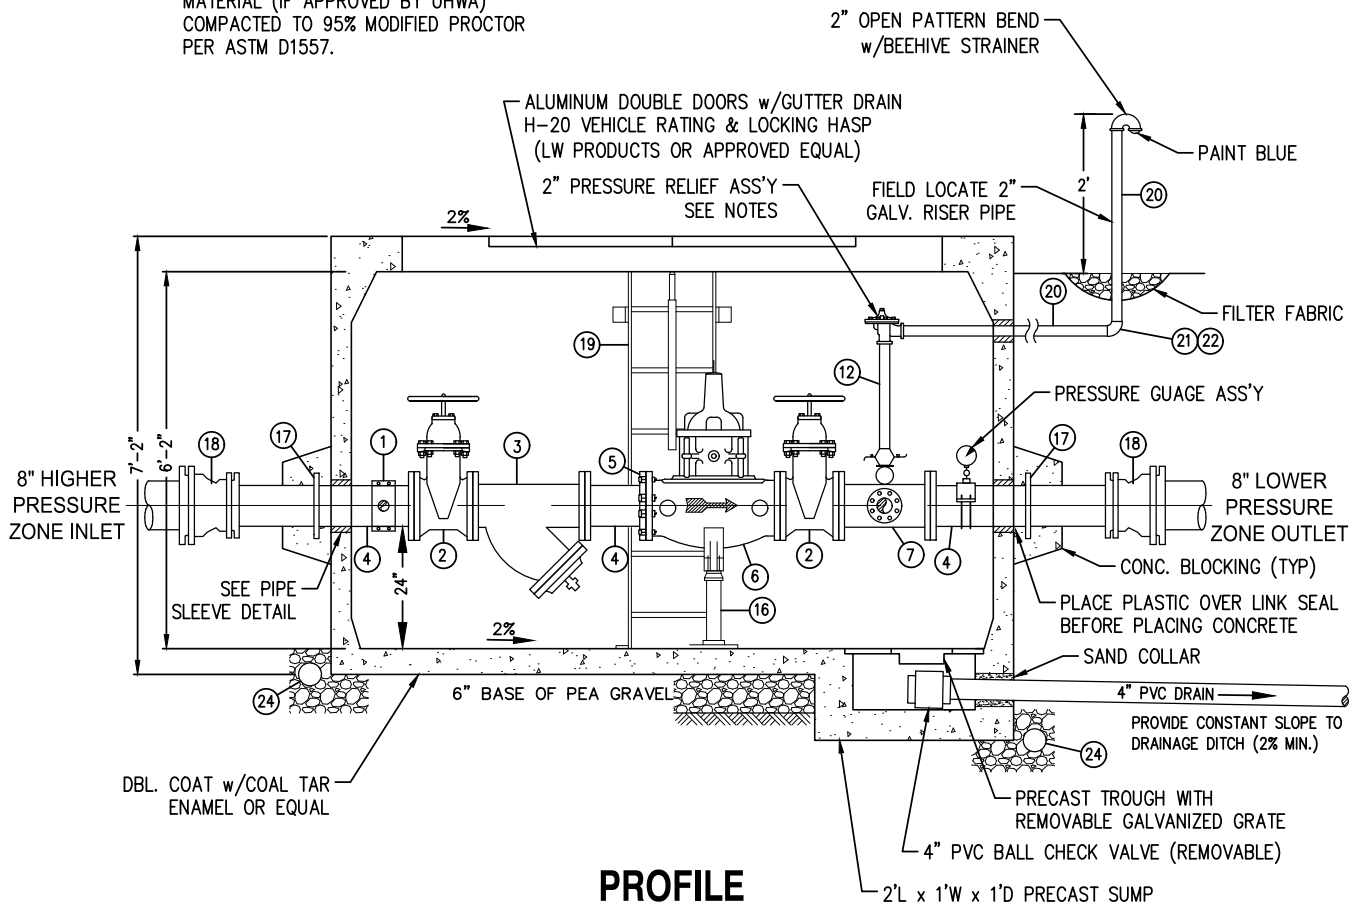

PROFILE

6" PRESSURE REDUCING STATION

1 OF 2

UNION HILL
WATER ASSOCIATION

WATER STANDARD DETAIL
W-41

SCALE: NTS DATE: JUNE 10, 2019

R:\CAD\DETAIL\AUTOCAD\UHWA\W-41 6IN PRV